

MARIS, KALVIN & ANN  
32317-395th Pl

Attn: M<sup>1</sup> 100° 00' - 406.00' ±


- NW 110° 19' 17" - 406.00' ±

TRACT B

NE 56° 00' 27" 72.00'

Sewer Shelter 8' x 10'  
Distance from sewer tanks 20'  
Distance from mound - 48'  
Distance from Sewer Lake  
line 28'  
Distance from water  
180'

I hereby certify  
that I am a  
licensed surveyor  
and that I am a  
member of the  
DATE 6/30/15  
revised ?

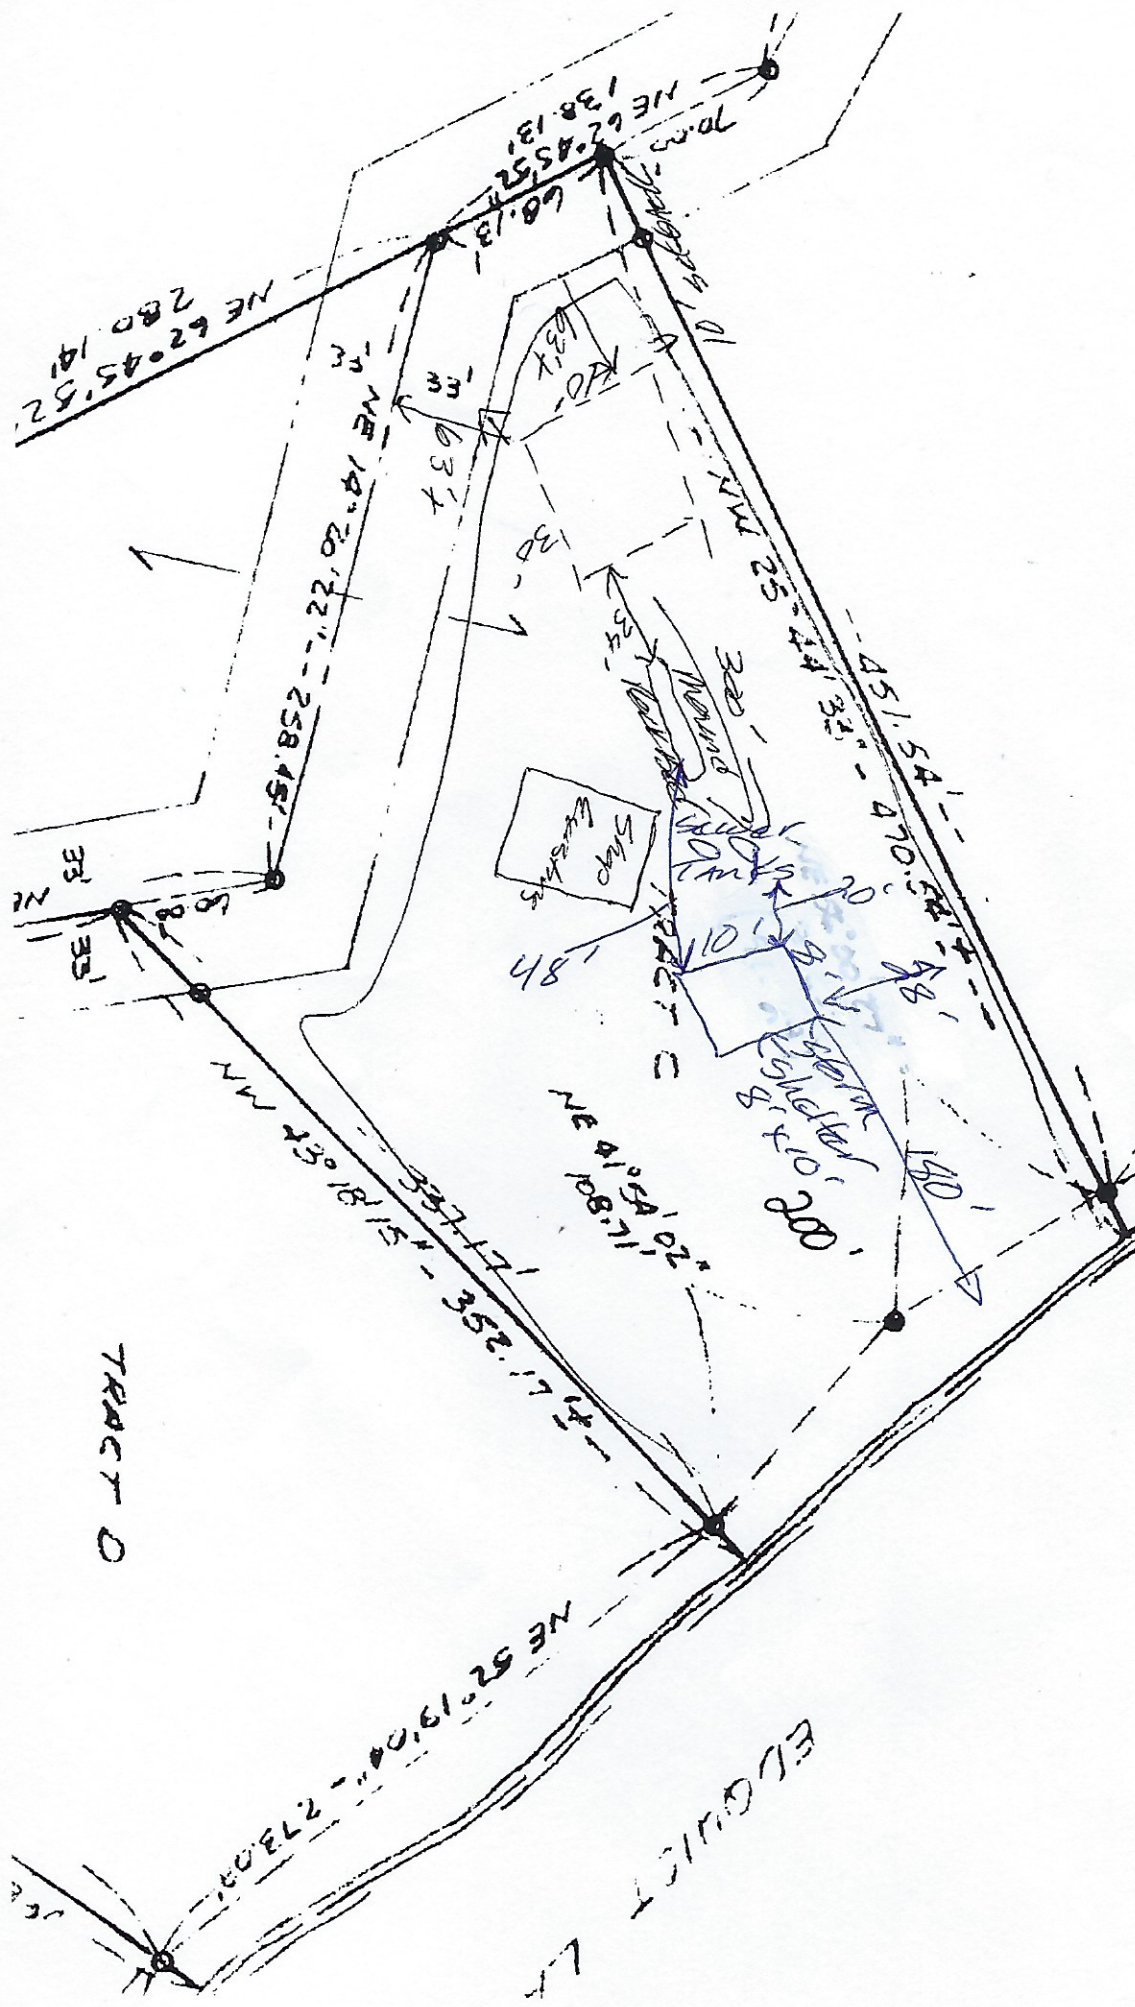

TRACT D

EL QUINCY LA