

AITKIN COUNTY
CERTIFICATE OF INSTALLATION/~~NOTICE OF NONCOMPLIANCE~~

This certificate of installation/~~notice of noncompliance~~ has been issued this _____ day of _____, 20____ to certify compliance/~~noncompliance~~ with Aitkin County's Subsurface Sewage Treatment System Ordinance.

The premises covered by this certificate are legally described as: _____

Section _____ Township _____ Range _____ Lake _____
PERMIT NO. _____ Owner Name _____
Address _____
Installer Name _____
Type of System Inspected _____
Parcel Number _____

The certificate of installation/~~notice of noncompliance~~ was based on No ___ of the following:

- 1) Inspection of the installation or construction as in accordance with the above referenced permit and application design.

- 2) Review of as-built plans submitted in accordance with Subdivision 9.2 D of Aitkin County's Subsurface Sewage Treatment System Ordinance.

If the above permitted subsurface sewage treatment system is in noncompliance with Aitkin County's Subsurface Sewage Treatment System Ordinance, then the following shall serve as a Notice of Violation:

- 1) Statement of the findings of fact through inspections or investigations:

- 2) List of specific violations of Ordinance: _____

- 3) Requirements for correction or removal of violations: _____

- 4) Time schedule for compliance: _____

Failure to correct or remove the above violation(s) will result in this matter being turned over to the Aitkin County Attorney's Office for further legal action, which may result in revocation of licenses or registrations, fines and/or imprisonment.

INSPECTOR SIGNATURE _____

**SUBSURFACE SEWAGE TREATMENT SYSTEM INSPECTION FORM
AITKIN COUNTY, MINNESOTA**

Township Lakeside Date of Inspection 8/3/2020 I App. Number 2020-6256
9/1/2020 F 45315
 Owner Mark Olson Parcel Number 16-1-105200
 Project Address 32527 183rd St. Installer Kohl's Concepts
 City Isle Zip Code 56342 T3 ZBR Mound

New Repair

DIST. or DROP BOX & TYPE —

SETBACKS:

TRENCHES, BEDS, OR GRAVELLESS LEACHFIELD:

Buildings to tank(s) 15'
 Buildings to drainfield 69'
 Well(s) 50' or 100' DW: 114' to tank
 Lake/Creek/Wetland —

Trench/Bed depth _____
 Trench/Bed length _____
 Trench/Bed bottom width _____
 Trench spacing _____
 Drainfield rock below pipe _____
 Size of gravelless pipe _____
 Depth of backfill _____
 Absorption area: square feet _____
 lineal feet _____

SEPTIC TANKS:

New Existing

MOUNDS:

Number of tanks installed 1
 Liquid capacity and type 1500 Cemstone (ex)
 Type of baffle Plastic

Percent slope 3%
 Upslope sand width 14'
 Downslope sand width 19'
 Sideslope sand width 14'
 Drainfield rock below pipe 9"
 Depth of sand below rock 36"
 Perforation size & spacing 0.25"/36" sp.
 Pipe size & spacing 2"/3' sp.
 Dimensions of rock bed 10' x 25'
 Dimensions of sand base 43' x 53'
 Final cover 12" cover over rb; 4" TS

Inspection pipes (1) 6"

Manholes size 24"


Manhole to grade Yes No

PUMPS:

New Existing

Tank capacity and type 520 Jac.
 Pump manufacturer & model # Zoeller 98
 Horsepower & GPM 0.5HP 18GPM
 Feet of head 16'
 Gallons per cycle 50GPC
 Size of discharge line 2"
 Type & location of alarm Elec.
 Water meter Event Counter

DRAWING OF SYSTEM: (include soils)

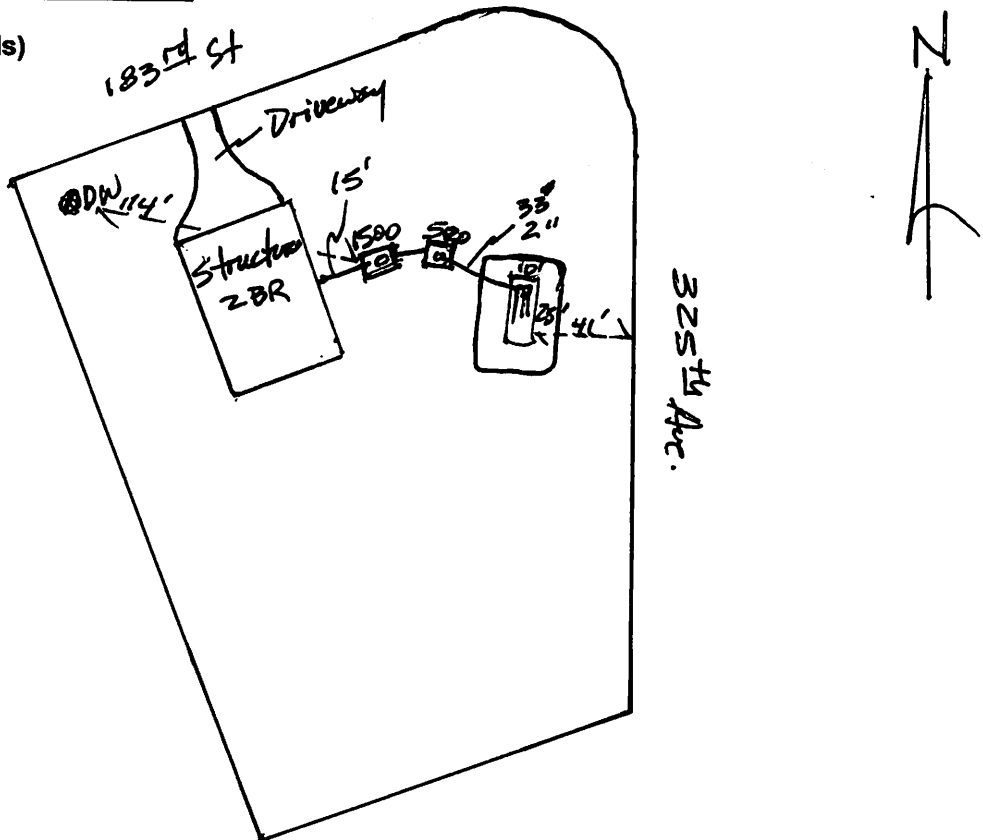

Inspector's Comments: _____

Inspector's Signature Bryan Hargrave Installer's Signature _____



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03



2020/08/03