

AITKIN COUNTY
CERTIFICATE OF INSTALLATION/~~NOTICE OF NONCOMPLIANCE~~

This certificate of installation/~~notice of noncompliance~~ has been issued this _____ day of _____, 20____ to certify compliance/~~noncompliance~~ with Aitkin County's Subsurface Sewage Treatment System Ordinance.

The premises covered by this certificate are legally described as: _____

Section _____ Township _____ Range _____ Lake _____

PERMIT NO. _____ Owner Name _____

Address _____

Installer Name _____

Type of System Inspected _____

Parcel Number _____

The certificate of installation/~~notice of noncompliance~~ was based on No ___ of the following:

- 1) Inspection of the installation or construction as in accordance with the above referenced permit and application design.

- 2) Review of as-built plans submitted in accordance with Subdivision 9.2 D of Aitkin County's Subsurface Sewage Treatment System Ordinance.

If the above permitted subsurface sewage treatment system is in noncompliance with Aitkin County's Subsurface Sewage Treatment System Ordinance, then the following shall serve as a Notice of Violation:

- 1) Statement of the findings of fact through inspections or investigations:

- 2) List of specific violations of Ordinance: _____

- 3) Requirements for correction or removal of violations: _____

- 4) Time schedule for compliance: _____

Failure to correct or remove the above violation(s) will result in this matter being turned over to the Aitkin County Attorney's Office for further legal action, which may result in revocation of licenses or registrations, fines and/or imprisonment.

INSPECTOR SIGNATURE _____

**SUBSURFACE SEWAGE TREATMENT SYSTEM INSPECTION FORM
AITKIN COUNTY, MINNESOTA**

2023-0363

Township Spencer Date of Inspection 6/20/2023 F App. Number 47801
6/12/2023 I

Owner Joe Baker Parcel Number 31-0-057101

Project Address 38588 St. Hwy 47 Installer Moritz Exc.

City Aitkin Zip Code 56431 TI 3BR mound

New Repair

DIST. or DROP BOX & TYPE ---

SETBACKS:
 Buildings to tank(s) 11'
 Buildings to drainfield 27'
 Well(s) 50' or 100' DW: 68' to tank
 Lake/Creek/Wetland ---


TRENCHES, BEDS, OR GRAVELLESS LEACHFIELD:
 Trench/Bed depth _____
 Trench/Bed length _____
 Trench/Bed bottom width _____
 Trench spacing _____
 Drainfield rock below pipe _____
 Size of gravelless pipe _____
 Depth of backfill _____
 Absorption area: square feet _____
 lineal feet _____

SEPTIC TANKS: New Existing
 Number of tanks installed (1) 2250 Tri Co. Sather
 Liquid capacity and type 1055 part tank / 4526
 Type of baffle Plastic
 Inspection pipes ---
 Manholes size 24"
 Manhole to grade Yes No

MOUNDS:
 Percent slope 2%
 Upslope sand width 15'
 Downslope sand width 17'
 Sideslope sand width 15'
 Drainfield rock below pipe 9"
 Depth of sand below rock 30"
 Perforation size & spacing 0.25"/36" sp.
 Pipe size & spacing 1.5"/36" sp.
 Dimensions of rock bed 10' x 38'
 Dimensions of sand base 42' x 68'
 Final cover 12" cover over rb; 4" TS

PUMPS: New Existing
 Tank capacity and type 722 part trombo
 Pump manufacturer & model # Liberty 253
 Horsepower & GPM 1/3 HP 29 GPM
 Feet of head 14'
 Gallons per cycle ---
 Size of discharge line 2"
 Type & location of alarm Elec. on tank
 Water meter ---

DRAWING OF SYSTEM: (include soils)

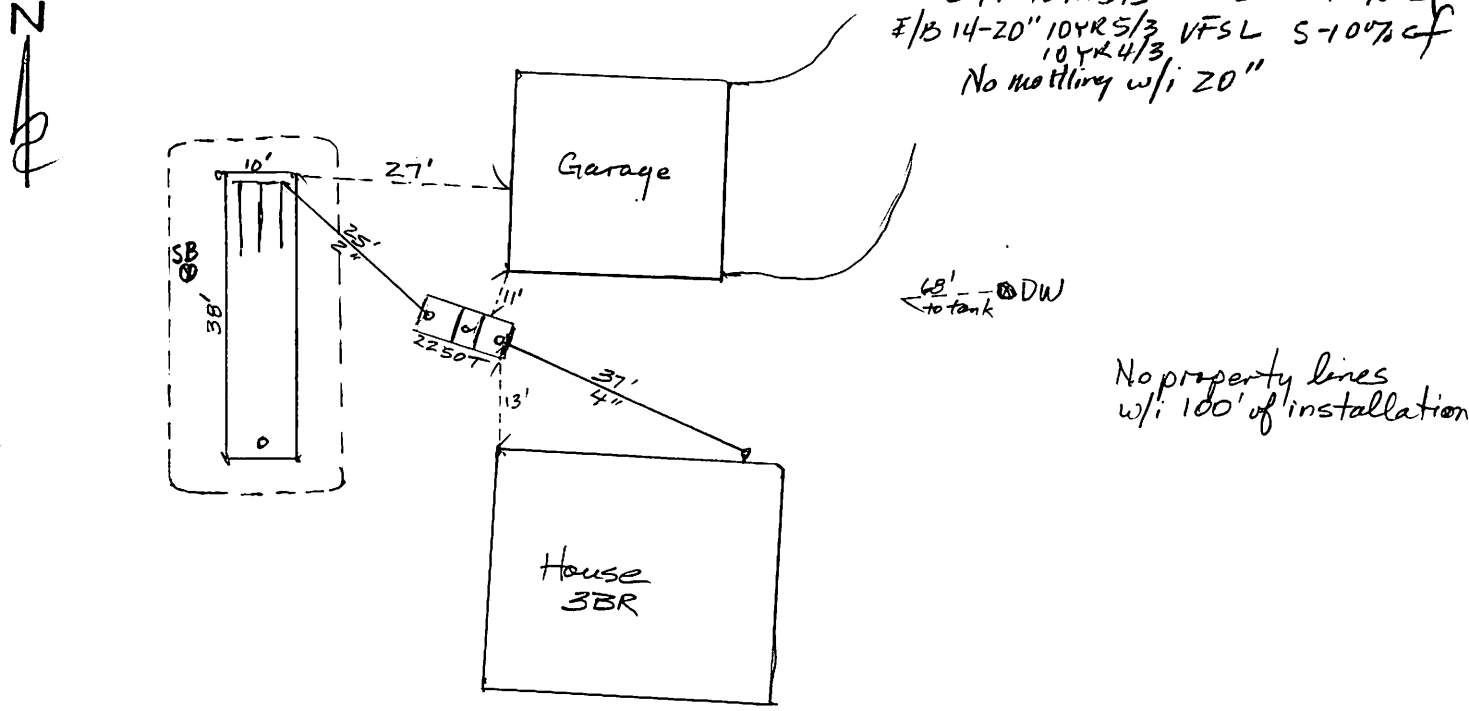

Inspector's Comments: _____

Inspector's Signature Bryan Hargrave Installer's Signature _____







