

AITKIN COUNTY
CERTIFICATE OF INSTALLATION/~~NOTICE OF NONCOMPLIANCE~~

This certificate of installation/~~notice of noncompliance~~ has been issued this _____ day of _____, 20____ to certify compliance/~~noncompliance~~ with Aitkin County's Subsurface Sewage Treatment System Ordinance.

The premises covered by this certificate are legally described as: _____

Section _____ Township _____ Range _____ Lake _____
PERMIT NO. _____ Owner Name _____
Address _____
Installer Name _____
Type of System Inspected _____
Parcel Number _____

The certificate of installation/~~notice of noncompliance~~ was based on No ___ of the following:

- 1) Inspection of the installation or construction as in accordance with the above referenced permit and application design.

- 2) Review of as-built plans submitted in accordance with Subdivision 9.2 D of Aitkin County's Subsurface Sewage Treatment System Ordinance.

If the above permitted subsurface sewage treatment system is in noncompliance with Aitkin County's Subsurface Sewage Treatment System Ordinance, then the following shall serve as a Notice of Violation:

1) Statement of the findings of fact through inspections or investigations:

2) List of specific violations of Ordinance: _____

3) Requirements for correction or removal of violations: _____

4) Time schedule for compliance: _____

Failure to correct or remove the above violation(s) will result in this matter being turned over to the Aitkin County Attorney's Office for further legal action, which may result in revocation of licenses or registrations, fines and/or imprisonment.

INSPECTOR SIGNATURE _____

INDIVIDUAL SEWAGE TREATMENT SYSTEM INSPECTION FORM
AITKIN COUNTY, MINNESOTA

Township Waukenabo Date of Inspection 8/23/2017 Permit Number 41932
 Owner Scott Nelson Parcel Number 35-0-025406
 Project Address 37961 495th Ln Installer Red Kern
 City Palisade Zip Code 56469 T3 ZBR Mound

New Repair

DIST. or DROP BOX & TYPE _____

SETBACKS:

TRENCHES, BEDS, OR GRAVELLESS LEACHFIELD:

Buildings to tank(s) 12'
 Buildings to drainfield 50'
 Well(s) 50' or 100' DW: 65' to tank
 Lake/Creek/Wetland Round Lake: 100'+

Trench depth _____
 Trench length _____
 Trench bottom width _____
 Trench spacing _____
 Drainfield rock below pipe _____
 Size of gravelless pipe _____
 Depth of backfill _____
 Absorption area: square feet _____
 lineal feet _____

SEPTIC TANKS: New Existing

MOUNDS:


Number of tanks installed 1
 Liquid capacity and type 1107G of 1650 Jumbo
 Type of baffle Plastic
 Inspection pipes 20"
 Manholes size 24"
 Manhole to grade Yes No

Percent slope 0% to
 Upslope dike width 15'
 Downslope dike width 15'
 Sideslope dike width 15'
 Drainfield rock below pipe 9" of 12" total
 Depth of sand below rock 36"
 Perforation size & spacing 0.25" 36" sp
 Pipe size & spacing 1.5" 3.5' sp.
 Dimensions of rock bed 10' x 25"
 Dimensions of sand base 40' x 55'
 Final cover 12" cover over rb; 4" + S

PUMPS: New Existing

Tank capacity and type 527G part of combo
 Pump manufacturer & model # Gould PE 41
 Horsepower & GPM 0.4 HP 18 GPM min
 Feet of head 13.22' min
 Gallons per cycle -
 Size of discharge line 2"
 Type & location of alarm SIE Rhombus on tank
 Water meter Event ctr. on tank

DRAWING OF SYSTEM: (include soils)

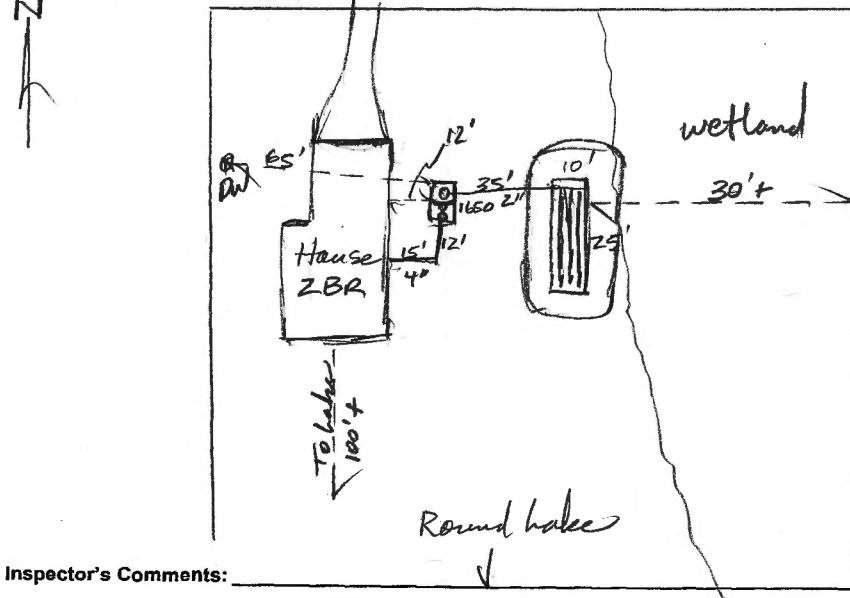

Inspector's Comments: _____

Inspector's Signature Brian Hograve Installer's Signature _____



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/23



2017/08/24



2017/08/24



2017/08/24